

# Information Sheet

## pH, ORP, Conductivity Manifold Assemblies

### Model Numbers

- 34750 -- pH/ORP Manifold Assembly (for Economy Electrode) 3/4" FSLIP
- 34751 -- pH/ORP Manifold Assembly (for Flat Surface Electrode) 3/4" FSLIP
- 35656 -- pH/ORP Manifold Assembly (for Economy Electrode) 3/4" NPT
- 35655 -- pH/ORP Manifold Assembly (for Flat Surface Electrode) 3/4" NPT
- 35657 -- Cooling Tower Probe & Manifold Assembly 3/4" NPT
- 34752 -- Cooling Tower Probe & Manifold Assembly 3/4" FSLIP



*These assemblies are designed for use with water only.  
They are not intended for use with chemicals.  
All chemical feed must be done downstream of the manifold.  
Failure to heed this warning could destroy the manifold!*



### Automatic Operation

The LMI Flow Switch ensures the shutdown of Liquitron™ Controller outputs in the event of system flow interruption.

### Backflow Prevention

The LMI Flow Switch incorporates a check valve to prevent backflow.

### Specifications

- Max. Temperature .... 140° F (60° C)
- Max. Pressure ..... 100 psi (6.9 Bar)
- Min. Flow ..... 0.75 GPM (170 l/h)
- Transmitter ..... Reed Switch (Flow Switch)
- Cable Length ..... 10 ft (3 m)
- Materials ..... Schedule 80 PVC Fittings

### General

The LMI series of Manifolds are designed for use with Conductivity, pH and ORP Wall Mount Controllers. They are intended to be installed in a bypass line of a cooling tower or other industrial water treatment system.

The flow switch will interrupt controller operation if flow is insufficient. The flow switch incorporates a check valve to prevent backflow.

### Operation

During operation, the switch will interrupt controller operation in the event that water flow decreases to less than 0.75 GPM (170 l/h) in the bypass line. This causes all output functions of the controller to cease, including shut down of all metering pumps. Control functions will automatically restart when water flow increases to 0.75 GPM or greater.

### Plumbing Connections

Inlet and outlet connections are 3/4" FSLIP, or 3/4 NPT.

**Note:** The flow switch must be installed upright with arrows pointing upwards, in the direction of flow.

### pH/ORP Electrode Installation

**Note:** The pH electrode must be installed vertically (see Figures 1 and 2 on back).

### Conductivity Probe Installation

The conductivity probe is connected to the controller by means of a cable with 4-pin connector. The flow switch is connected to the controller by hard wiring to the terminal block or some versions are equipped with a connector.


**Note:** See the LMI Conductivity, pH, and ORP Controller Instruction Manuals for complete installation instructions.




201 Ivyland Road  
Ivyland, PA 18974 USA  
TEL: 215-293-0401  
FAX: 215-293-0445  
<http://www.lmipumps.com>

# Instruction Sheet


## pH, ORP, Conductivity Manifold Assemblies

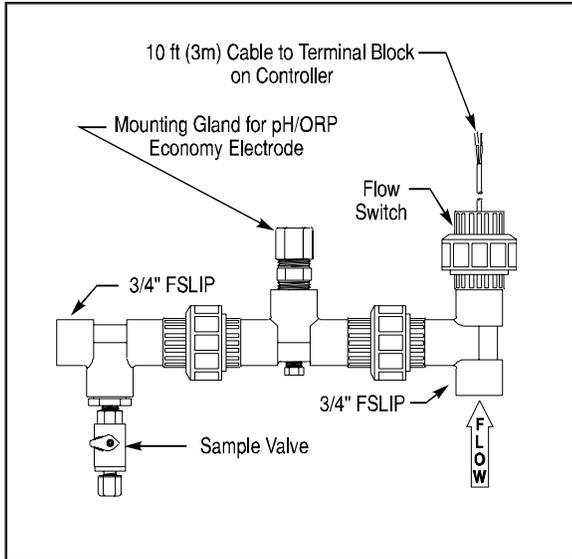


**Figure 1**  
Manifold (pH and ORP)  
Model No. 34750

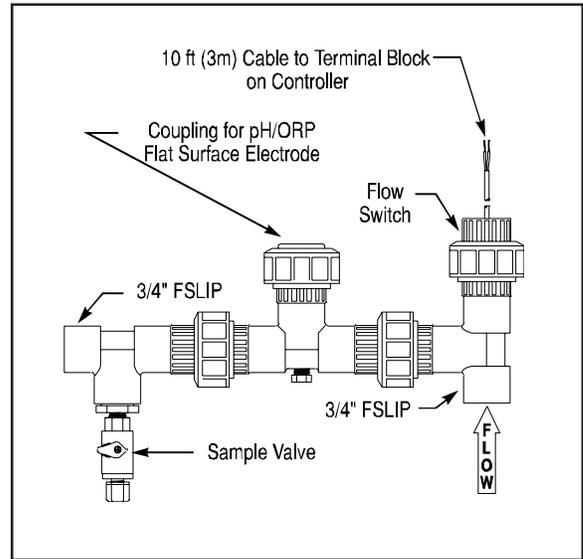


**Figure 2**  
Manifold (pH and ORP)  
Model No. 34751

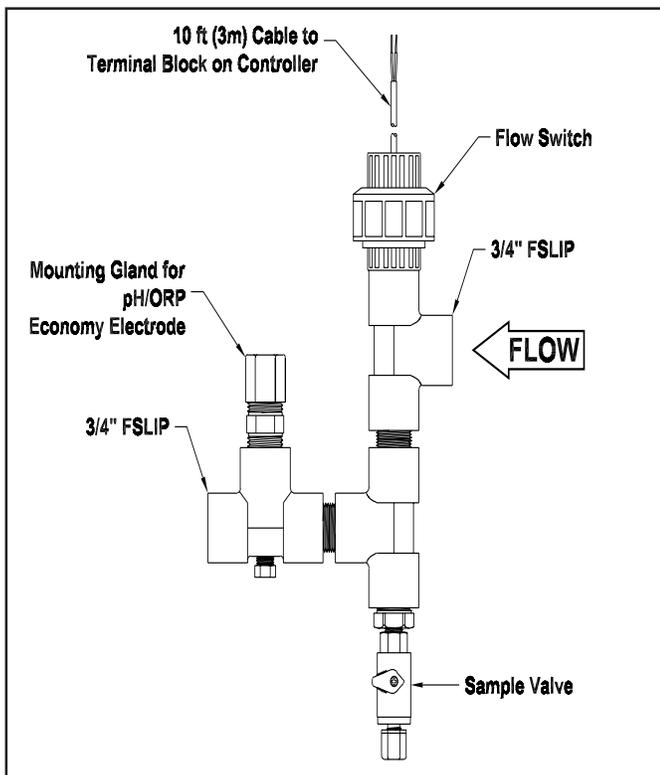


**Figure 3**  
Manifold (pH and ORP)  
Model No. 35656

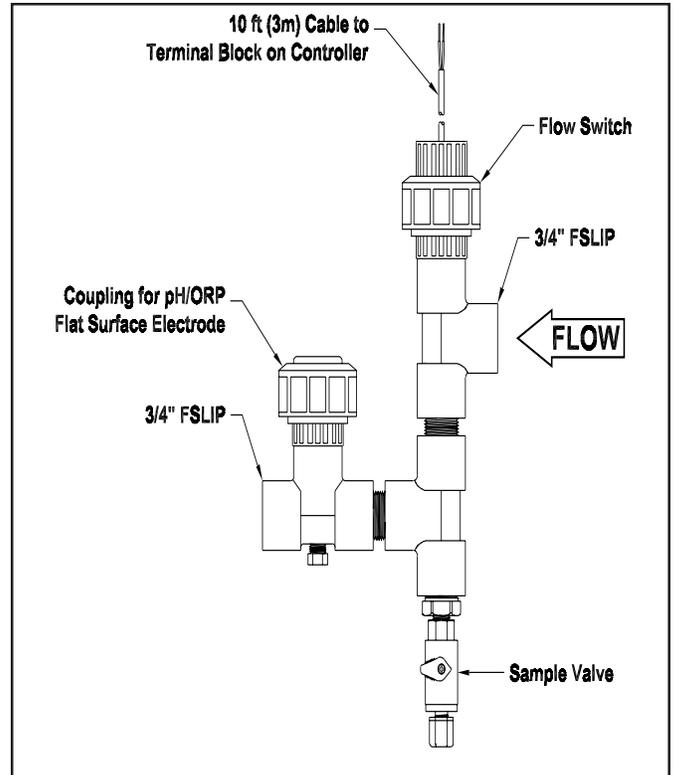

**Figure 4**  
Manifold (pH and ORP)  
Model No. 35655

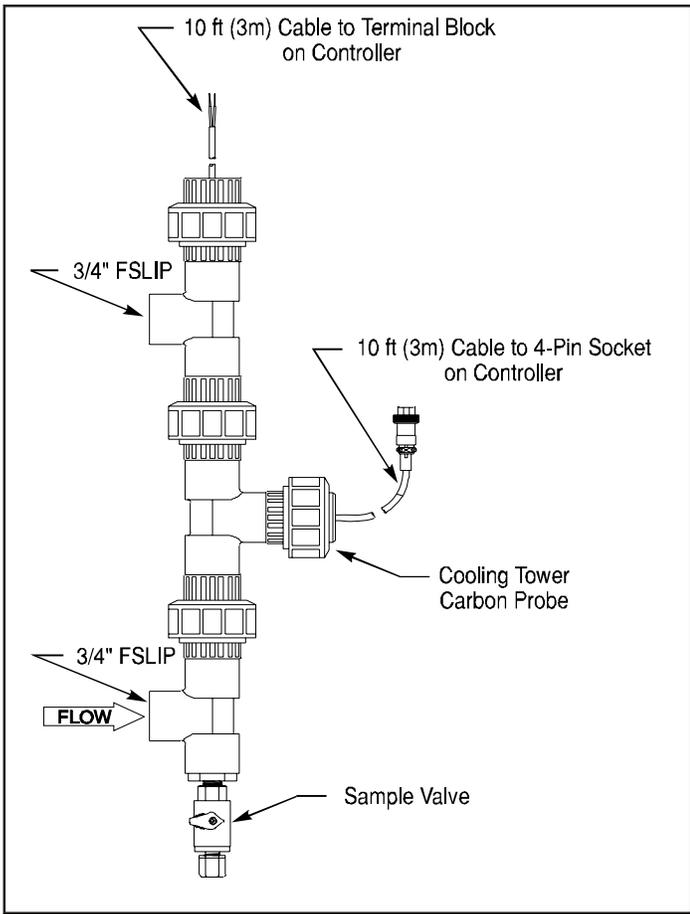

**Figure 5**  
 Manifold (Conductivity)  
 Model No. 34752

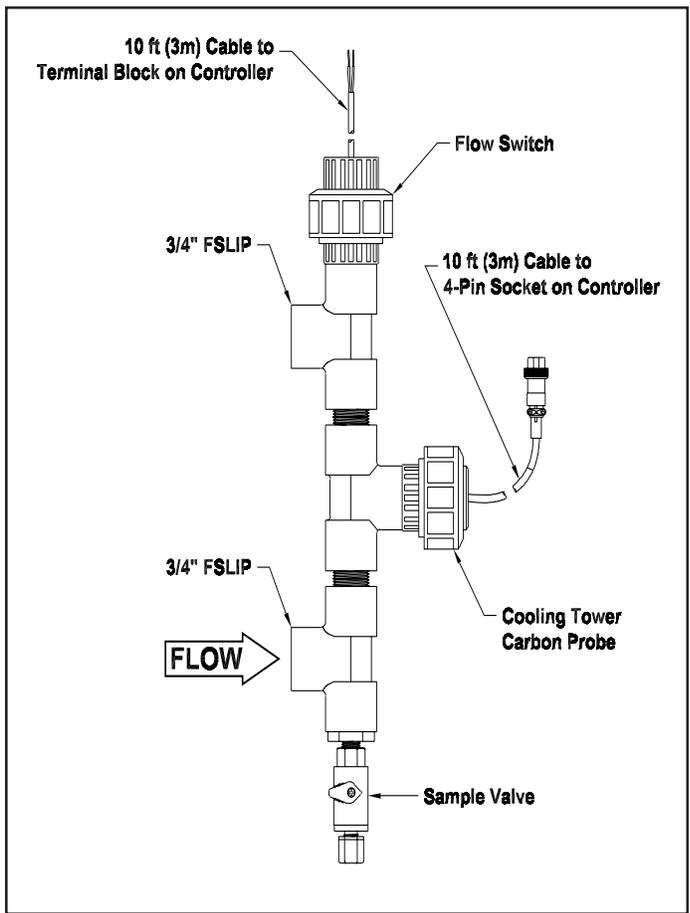

**Figure 6**  
 Manifold (Conductivity)  
 Model No. 35657

