

Liquid End Sheet

LE-11S/ LE-12S/ LE-15S

When pumping solutions, make certain that all tubing is securely attached to the fittings. It is recommended that tubing or pipe lines be shielded to prevent possible injury in case of rupture or accidental damage. Always wear protective clothing and face shield when working on or near your metering pump.

Note: See parts list for materials of construction

A. INSTALLING INJECTION CHECK VALVE

1. The purpose of the injection check valve is to prevent backflow from the treated line.
2. A 1/2" NPT female fitting with sufficient depth will accept the injection check valve.
3. To insure correct seating of the ball inside the injection check valve, the injection check valve should be installed upwards (vertically) into bottom of the pipe.

B. CONNECTING DISCHARGE TUBING

Note: Cut tubing to length needed for discharge line.

1. Route tubing from the injection check valve to the metering pump, making sure it does not touch hot or sharp surfaces, or is bent so sharply that it kinks.
2. Slide the small end of the coupling nut onto tubing.
3. Push tubing on the valve housing nozzle so that tubing flares out and butts up against valve housing and will not go any further.
4. Slide the coupling nut to the threads and engage. While pushing the tubing on to the valve housing nozzle, tighten the coupling nut by hand until tubing is held securely in place.

**Excessive force will crack or distort fittings.
DO NOT OVERTIGHTEN.**

C. CONNECTING SUCTION TUBING

1. Cut suction tubing to a length so that the foot valve hangs just above the bottom of the solution container. Maximum recommended vertical suction lift is 5 ft (1.5 m).
2. Follow same procedure in connecting suction tubing to suction valve and foot valve (see **B. Connecting Discharge Tubing**).

D. PRIMING

1. Connect pressure relief tubing to pressure relief port on the four function valve.
2. Route tubing to solution reservoir and anchor with a plastic tie. Do not submerge tubing in solution.
3. Start pump. Set at 80% speed and 100% stroke.
4. Turn Pressure Relief knob (black knob) 1/4 turn. Let pump run until solution is visible through translucent return tubing.
5. Turn Pressure Relief knob back 1/4 turn. The pump is now primed.

Note:

- (a) Pump is normally self-priming if suction lift is not more than 5 ft (1.5 m), valves in the pump are wet with water (pump is shipped from factory with water in pump head) and the above steps (**D. Priming**) are followed.
- (b) If the pump does not self prime, remove discharge valve housing and ball, and pour water or solution slowly into discharge port until head is filled. Follow step **D. Priming** thereafter.

E. DEPRESSURIZING DISCHARGE LINE

1. It is possible to depressurize the discharge line and pump head without removal of tubing or loosening of fittings.

Be sure injection check valve is properly installed and is operating. If a gate valve or globe has been installed downstream of injection check valve, it should be closed. Be certain relief tubing from the four function valve is connected and run to solution reservoir.

2. Pull on both anti-syphon and relief knobs.
3. The discharge line is now depressurized.
4. If the injection check valve is of higher elevation than the pump head, disconnecting tubing at injection check valve end will allow air to enter and cause solution to drain back to the tank.



8 Post Office Square
Acton, MA 01720 USA
TEL: (978) 263-9800
FAX: (978) 264-9172
<http://www.lmipumps.com>



Replaces same of Rev. E 7/96
1461.F 11/97

KEY NO.	PART NO.	DESCRIPTION	QUANTITY		
			LE-11S	LE-12S	LE-15S
2	29339*	Spring, P.E.	1		
	10339 + #	Spring, PVDF		1	1
3	10338 + #	Ball, Ceramic	4	4	4
4	29443 +	Seal Ring, Polyprel	4	4	
	10407#	Seal Ring, PTFE			4
5	10492	Valve Seat, PVC	2	2	
	10792	Valve Seat, Ivory, Polypropylene			2
6	10411	Coupling Nut	4	4	4
7	10142-10	Tubing, .500" O.D. Polyethylene	1		
	10142-16	Tubing, .500" O.D. Polyethylene		1	1
8	10493	Valve Housing, PVC	1	1	
	10793	Valve Housing, Ivory, Polypropylene			1
9	10340 ^A	Screw, 10-24 x 3/4" S.S.	4	4	4
10	31419	Liquifram™, 3.0 SI, Fluorofilm™	1	1	1
11	29552	Head, 3.0 SI, Acrylic	1		
	29553	Head, 3.0 SI, PVC		1	
	29554	Head, 3.0 SI, Ivory, Polypropylene			1
13	10978	Foot Valve Seat	1	1	1
14	10123	Strainer, Polypropylene	1	1	1
15	27610	Injection Check/Valve Assembly	1		
	27615	Injection Check/Valve Assembly		1	
	25104	Injection Check /Valve Assembly			1
17	27612	Suction Valve Assembly	1	1	
	25107	Suction Valve Assembly			1
18	27613	Foot Valve Assembly	1	1	
	25109	Foot Valve Assembly			1
19	29750	Head Assembly, LE-11S	1		
	29756	Head Assembly, LE-12S		1	
	29762	Head Assembly, LE-15S			1
20	10141-06	Tubing, Vinyl .500" O.D.	1		
21	31137	Anti-Syphon/Pressure Release Assembly	1		
	27043	Anti-Syphon/Pressure Release Assembly		1	
	25900	Anti-Syphon/Pressure Release Assembly			1
22	31139	Pressure Release Cap Assembly	1		
	28447	Pressure Release Cap Assembly		1	
	28446	Pressure Release Cap Assembly			1
23	31138	Anti-Syphon Cap Assembly	1		
	27045	Anti-Syphon Cap Assembly		1	
	25838	Anti-Syphon Cap Assembly			1
	25627	Screw, 6-32 x 1 1/4" S.S. (not shown)	4	4	4
26	27352	Flapper Valve	1	1	
27	10294	Injector Fitting, PVC	1		
	26841	Injector Fitting, PVDF		1	
	10394	Injector Fitting, P.P.			1
35	30426	Valve Body, PVC	1		
	26856	Valve Body, PVDF		1	
	25870	Valve Body, P.P.			1
37	25631	Nut, Ferrule	1	1	1
38	25636-10	Tubing, .250" O.D., Polyethylene	1	1	1
---	32293	Suction Tubing Straightener (not shown)	1	1	1
---	25628	Nut, 6-32 Hex S.S. (not shown)	4	4	4


+ Parts included in Spare Parts Kit No. SP-U17

Parts included in Spare Parts Kit No. SP-15

^A For Use with LMI Series M Metering Pumps, Order P/N 31112, Screw 10-24 x 1.5" SS 4 ea

NOTE:

Threaded connections into pump head are 3/4" - 16 straight threads. **DO NOT USE TEFLON® TAPE.** These joints are sealed by seal ring valve seats (item 4 on exploded view).

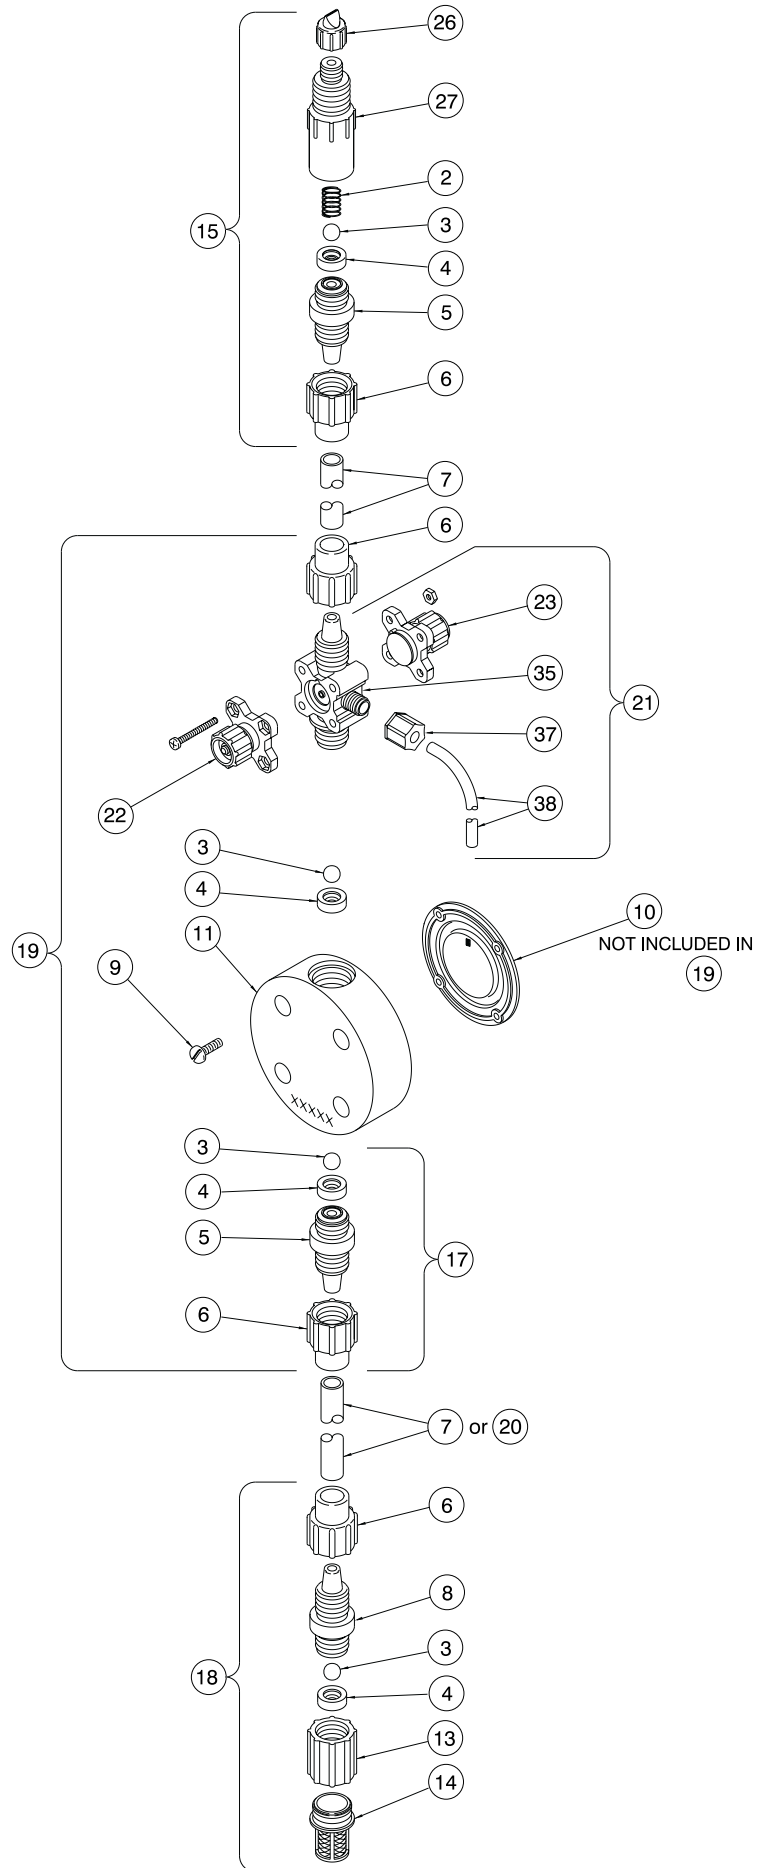



**8 Post Office Square
Acton, MA 01720 USA
TEL: (978) 263-9800
FAX: (978) 264-9172
<http://www.lmipumps.com>**